

Hub 01



Thermostatic concealed two-way shower valve

- Recommended for use with Florin 31-43, Soriano 31-43, Staffordshire 31-43 and Tubo 31-43
- 0.5bar minimum



Thermostatisches, verdeckt eingebautes zwei-Wege Duschventil

- Empfohlen zum Einsatz mit Florin 31-43, Soriano 31-43, Staffordshire 31-43 und Tubo 31-43
- Mindestdruck 0,5bar



Corps thermostatique + inverseur 2 voies à encastrer

- Recommandée pour un usage avec Florin 31-43, Soriano 31-43, Staffordshire 31-43 et Tubo 31-43
- Minimum 0,5bar



Válvula termostática de ducha 2 vías

- Recomendada para su uso con Florin 31-43, Soriano 31-43, Staffordshire 31-43 y Tubo 31-43
- Mínimo 0,5bar



Valvola doccia per Miscelatore termostatico ad incasso a due vie


- Raccomandato per l'uso con Florin 31-43, Soriano 31-43, Staffordshire 31-43 e Tubo 31-43
- Minimo di 0,5bar



Massachusetts Code: File No. Pending
 cUPC listing (ASME & CSA) by IAPMO: File No. Pending
 Lead Free listing (Safe Drinking Water Act & California
 Health & Safety Code) by IAPMO: File No. Pending
 Drinking Water Listing (NSF 61) by IAPMO: File No. Pending

Hub 01

HUB-01-UF

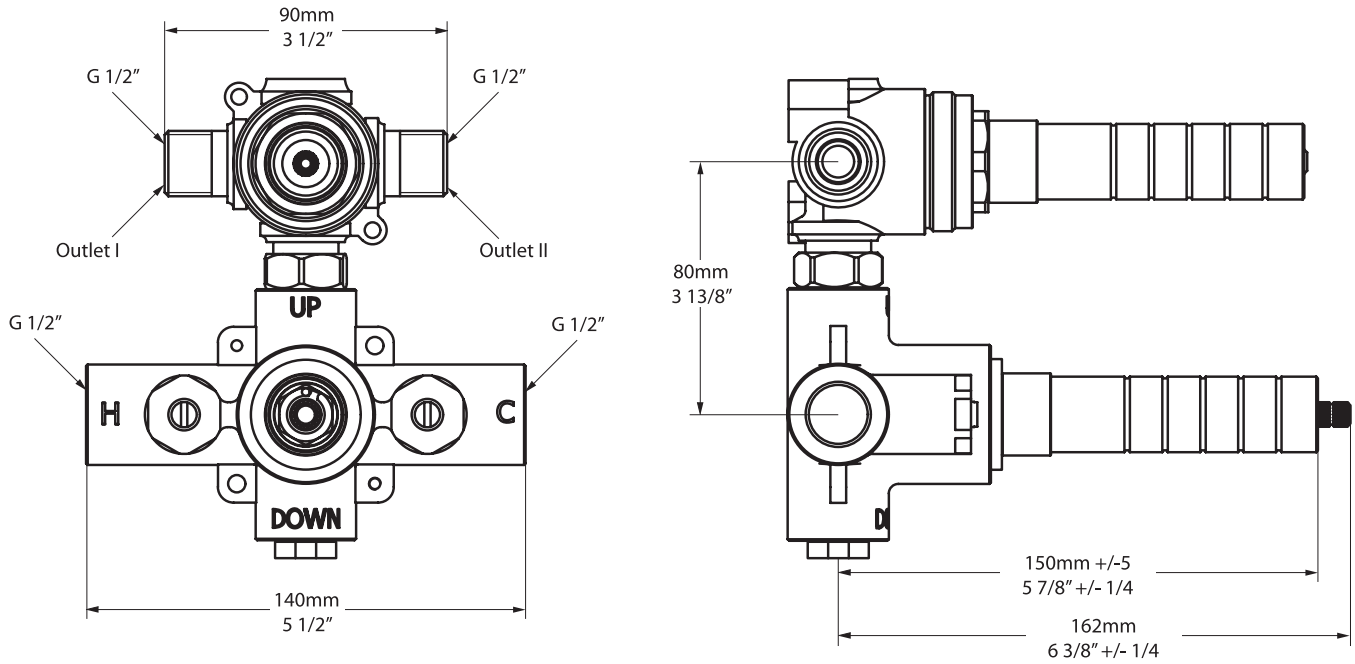

Hub 01

UK 0.5bar minimum, 1.0bar recommended
 DE 0,5bar Minimum 1.0bar empfohlen
 FR Minimum 0,5bar, 1,0bar recommandée
 ES Mínimo 0,5bar, 1,0bar recomendado
 IT Minimo di 0,5bar, 1,0bar raccomandata

*All measurements subject to +/-5% tolerance

Pressure (bar)	0.5	1.0	1.5	2.0	3.0	4.0	5.0
Flow (lpm)*	6.7	11.6	15.2	18.3	23.3	27.3	31.1

*Open outlet



.dwg | .dxf | .skp www.vandabaths.com



Massachusetts Code: File No. Pending
 cUPC listing (ASME & CSA) by IAPMO: File No. Pending
 Lead Free listing (Safe Drinking Water Act & California
 Health & Safety Code) by IAPMO: File No. Pending
 Drinking Water Listing (NSF 61) by IAPMO:
 File No. Pending

VA/1204/02/Aug18